


EDWARDSBURGH CARDINAL TOWNSHIP

JOHNSTOWN DRAINAGE OPTION 2

LIST OF DRAWINGS

C0-00	COVER
C1-00	SOPHIA AND MARY SITE PLAN
C2-00	DETAILS

THE GREER GALLOWAY GROUP INC.
ENGINEERS PLANNERS

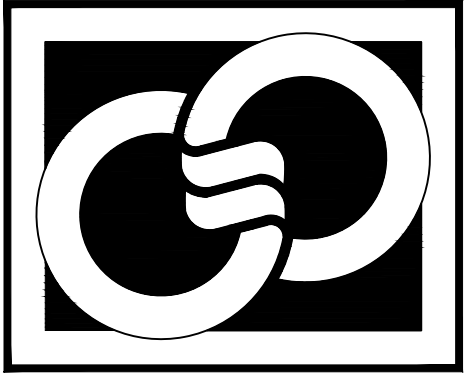

PETERBOROUGH
BELLEVILLE
KINGSTON

640 CATARAQUI WOODS DRIVE, UNIT 2A
KINGSTON, ONTARIO K7P 2Y5
PHONE: (613) 536-5420


CAD OPERATOR:Ghoegi

CAD FILE: P:\Kingston Project\5000 - Municipal\2155250 - Johnstown - Johnstown - Township Of Edwardburgh\Drawings\Johnstown Preliminary Option 2.dwg

PLOT SCALE: AS NOTED

DATE PLOTTED: DD/MM/YYYY

GSG-A1

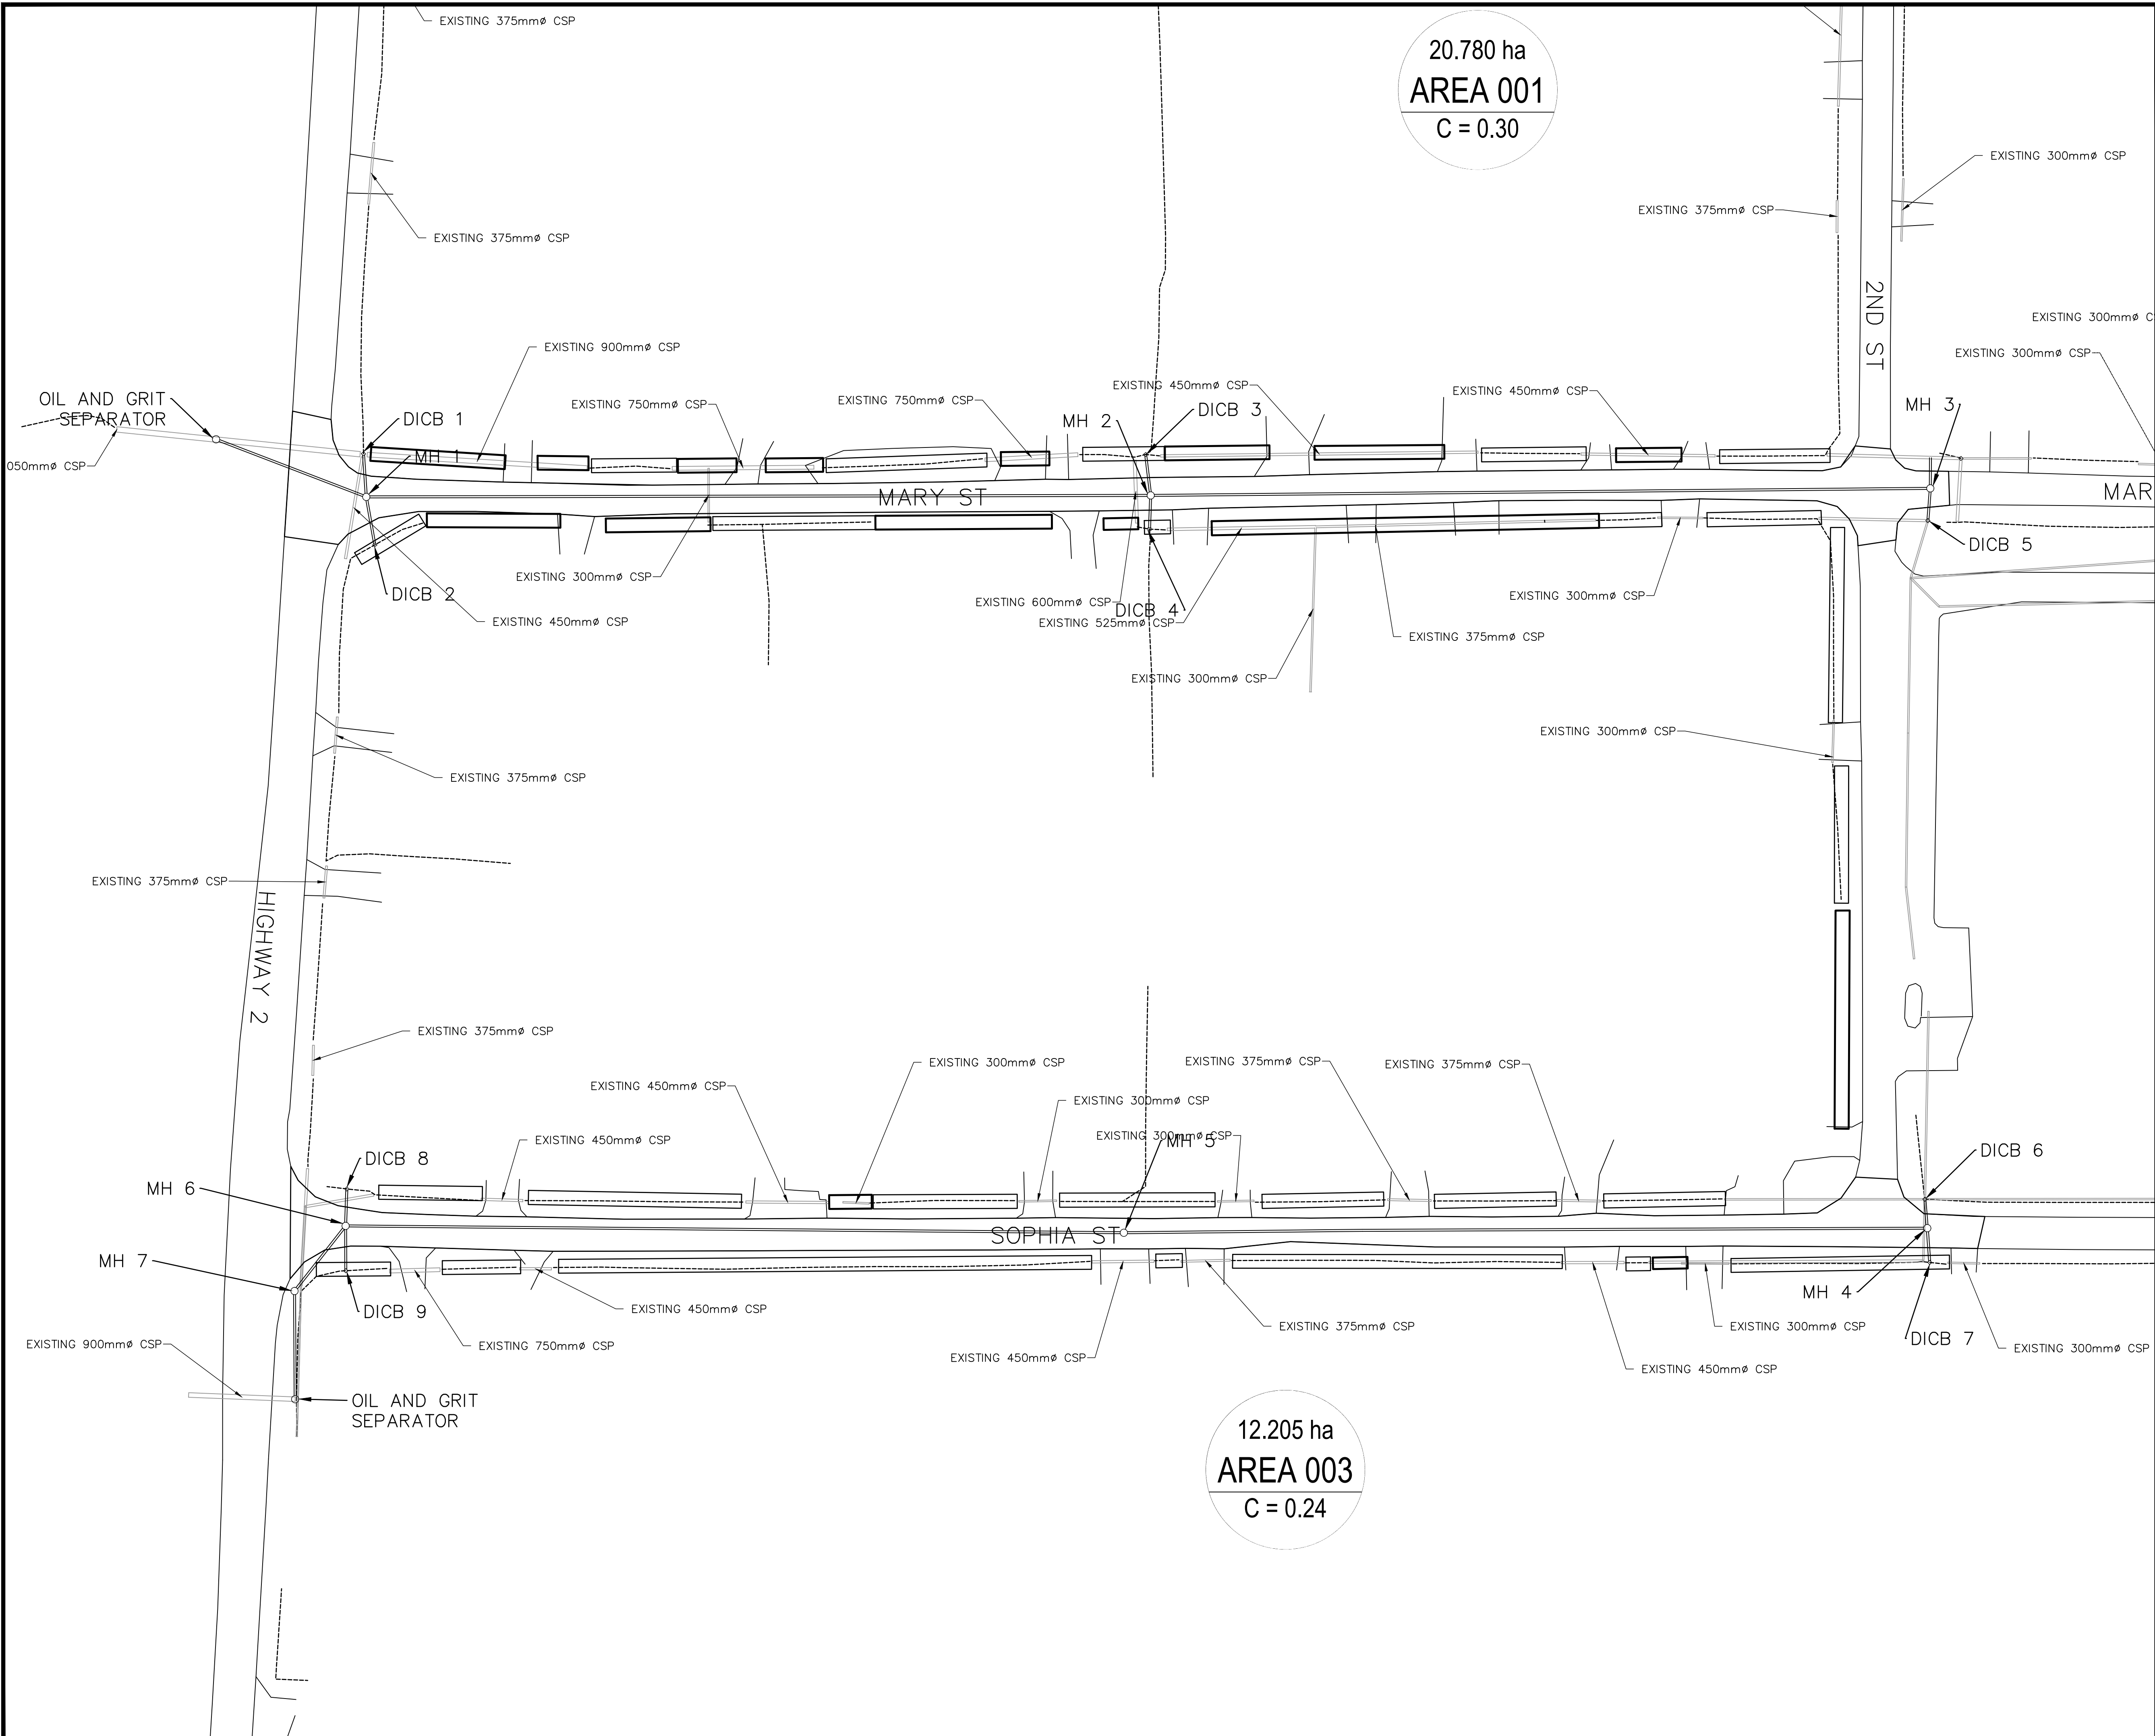

THE GREER GALLOWAY GROUP INC.
ENGINEERS & PLANNERS
PETERBOROUGH
BELLEVILLE
KINGSTON
640 CATARAQUI WOODS DRIVE #2A
KINGSTON, ONTARIO, K7P 2Y5
PHONE: 613-536-5420
FAX: 613-548-3793

NOTES:

1. ALL WORK SHALL BE IN ACCORDANCE WITH RELEVANT CODES AND GUIDELINES.
2. ALL DRAWINGS AND ADDENDA ARE TO BE READ AS, AND IN CONJUNCTION WITH THE SPECIFICATIONS.
3. ALL EQUIPMENT SHALL BE INSTALLED AS SPECIFIED OR APPROVED EQUIVALENT.
4. CONTRACTOR MUST CHECK AND VERIFY ALL DIMENSIONS BEFORE PROCEEDING WITH WORK AND BE RESPONSIBLE FOR SAME.
5. CONTRACTOR MUST REPORT ANY DISCREPANCIES TO ENGINEER FOR RESOLUTION BEFORE COMMENCING THE WORK.
6. ANY CHANGES MUST BE APPROVED BY THE ENGINEER.

A

B

A DETAIL NO.
B DRAWING NO. - WHERE DETAILED

LEGEND

PROPOSED STORM

EXISTING STORM

AREAS OF DITCHING

FLAT AREAS

NORTH

STAMP

PROJECT

JOHNSTOWN DRAINAGE
OPTION 2

JOHNSTOWN, ON

TOWNSHIP OF EDWARDBURGH

DRAWING TITLE

SOPHIA AND MARY
SITE PLAN

05		
04		
03		
02		
01		
REVISION		DATE

DESIGNED BY

DRAWN BY

G.HOEGI

REVIEWED BY

APPROVED BY

PROJECT DATE

06/16/2021 (DD/MM/YYYY)

PROJECT #	SCALE
21-5-5250	HOR: 1:600 VER: NTS

DRAWING #

C100

(METRIC SCALE - ALL DIMS IN METERS UNLESS OTHERWISE SPECIFIED)



1 Outlet hole size 525mm max diameter.				
A Where inlet is placed across ditch and is accessible to vehicular traffic, grating slope shall be 6H:1V or flatter.				
B Center reinforcing in wall and base slab ± 25 mm.				
C Lap riser horizontal wires 300mm. Laps shall be placed at corners.				
D Granular backfill shall be placed to a minimum thickness of 300mm all around the ditch inlet.				
E Grating shall be according to OPSD 403.010.	ONTARIO PROVINCIAL STANDARD DRAWING		Nov 2019	Rev 4
F Pipe support shall be according to OPSD 708.020.	PRECAST CONCRETE DITCH INLETS 600 x 1200mm		-----	
G All dimensions are nominal.			-----	
H All dimensions are in millimetres unless otherwise shown.			OPSD 705.040	